
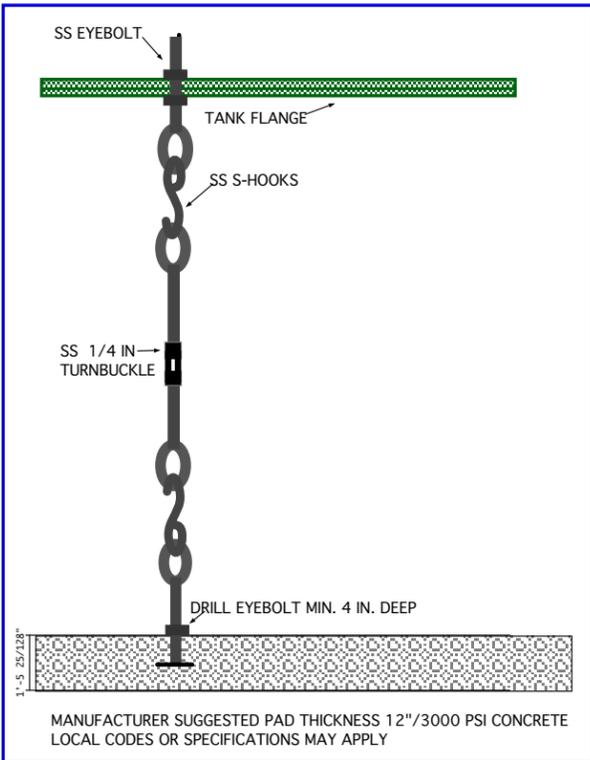



PLAN VIEW

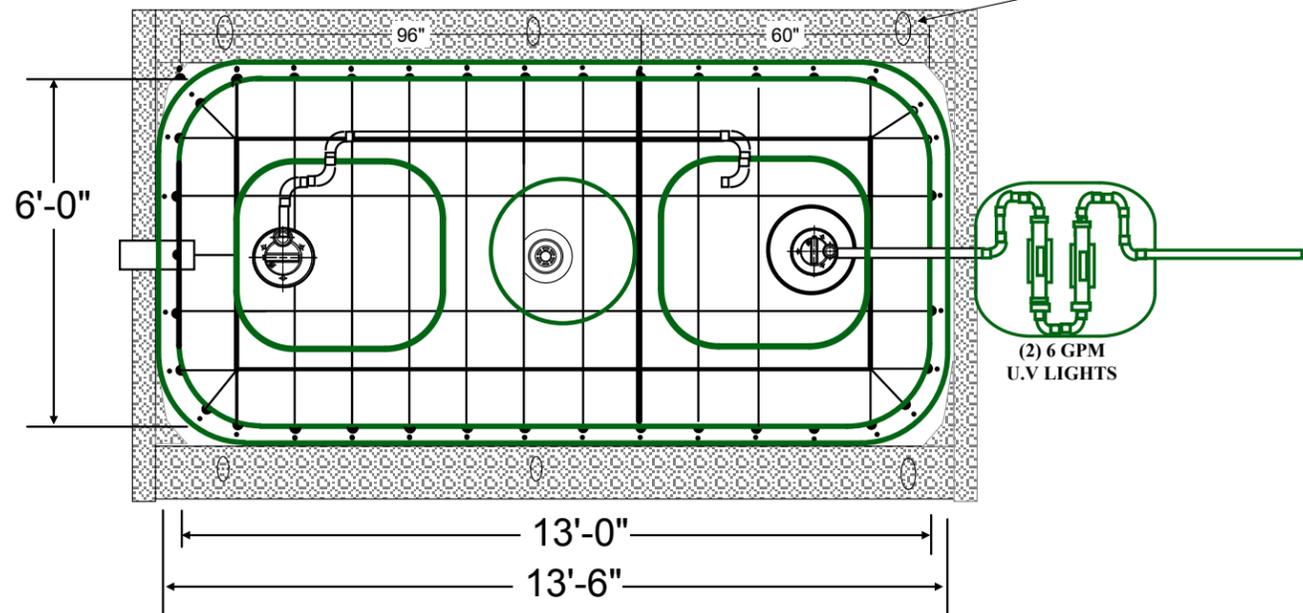

REMOVAL EFFICIENCIES
BASED ON MEDIAN OF VALUES
TESTED BY THE NSF 1993


	INFLUENT AVERAGE	EFFLUENT AVERAGE	REDUCTION	PERCENT REDUCTION
BOD MG/L	170	<5	167	98 %
SS MG/L	200	<5	196	98 %

GAST REGENAIR R3105-1 BLOWER


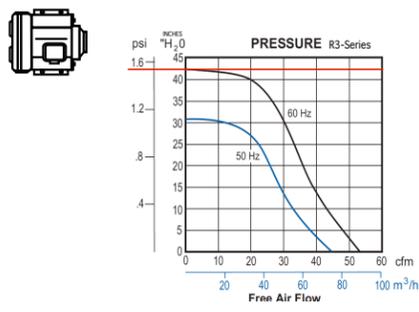


SECTION VIEW

EQUIPMENT NOTES:
 BLOWER- GAST MODEL R3105-1 230V 60 HZ 1PH 2.8 AMPS, 1/2 HP.
 PUMP # 1, 2, 3 - GOULDS LSP0712F 230V 60HZ 3/4 HP 1PH 3.5 AMPS
 UV Lights: (2) 3 GPM SANITRON S17A

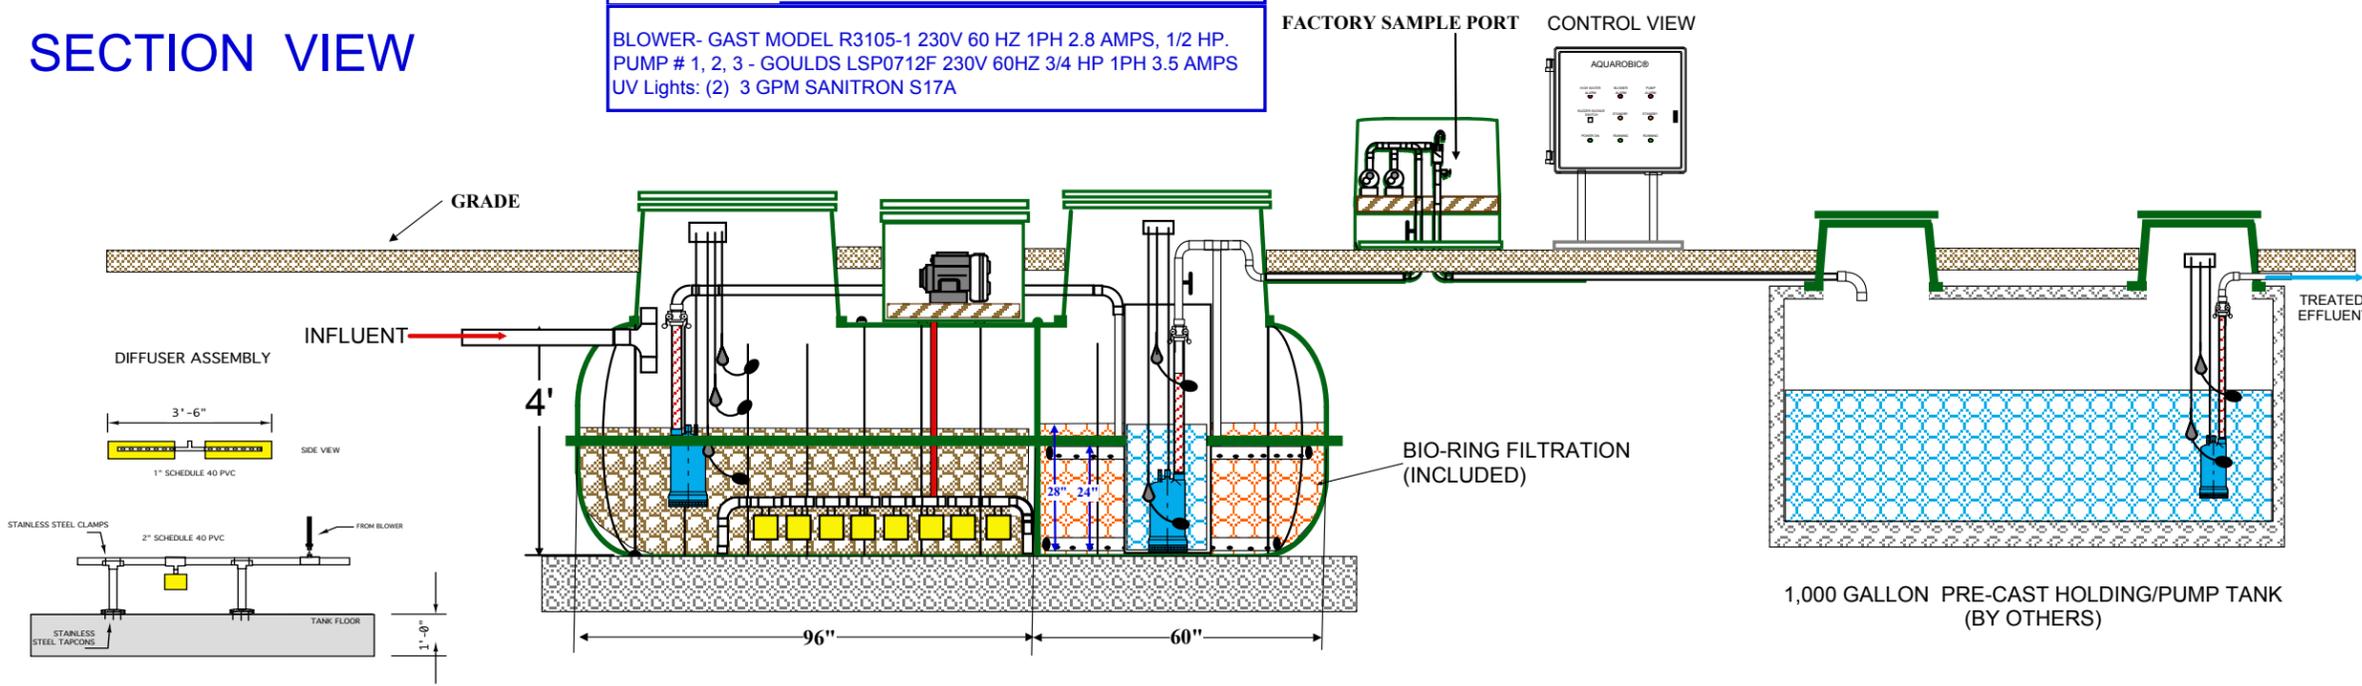

GOULDS PUMP LSP0712F

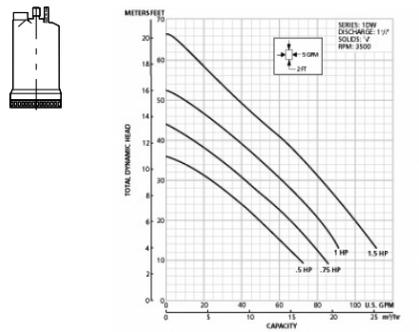

CONFIDENTIAL NOTICE

THIS DOCUMENT CONTAINS INFORMATION THAT IS CONFIDENTIAL AND PROPRIETARY TO AQUAROBIC INTERNATIONAL, INC..
 THE INFORMATION MAY NOT BE USED, DISCLOSED OR REPRODUCED WITHOUT THE PRIOR WRITTEN AUTHORIZATION OF AQUAROBIC INTERNATIONAL, INC., AND THOSE SO AUTHORIZED MAY ONLY USE THE INFORMATION FOR THE PURPOSE OF EVALUATION CONSISTENT WITH AUTHORIZATION.
 REPRODUCTION OF ANY SECTION OF THIS DOCUMENT MUST INCLUDE THIS LEGEND.

**AQUAROBIC
 MINI-PLANT WITH
 RECIRCULATING FILTER
 AND UV DISINFECTION**

NSF 1993 CLASS ONE REMOVAL WITH REUSE CAPABILITIES OF 450 GPD
 Bod & SS < 5 mg/L

PETER & ASSOCIATES
 1519 CALLE VALLE
 SAN CLEMENTE, CA 92672
MR. STEVE PETER
 THOURBANOV RESIDENCE

**AQUAROBIC
 MINI-PLANT
 MODEL 54291-5-S**
 DWG BY: LJM
 DATE: 12/29/20
 SCALE: NTS

AquaO2
 Wastewater Treatment Systems, Inc.
 Formerly Aquarobic International, Inc.

5800 PRILLAMAN SWITCH RD. FERRUM, VA 24088
 PH: 540-365-0154 FAX: 540-365-0155
 WWW.AQUA-O2.COM
 1-800-927-8304